

Rosemount™ 2120 Level Switch

Vibrating Fork



1 Product certifications

Rev 8.25

1.1 European directive information

A copy of the EU Declaration of Conformity can be found at the end of the document. The most recent revision of the EU Declaration of Conformity can be found at [Emerson.com/Rosemount](https://www.emerson.com/Rosemount).

1.2 Safety Instrumented Systems (SIS)

SIL 3 Capable: IEC 61508 certified for use in safety instrumented systems up to SIL 3 (Minimum requirement of single use (1oo1) for SIL 2 and redundant use (1oo2) for SIL 3).

1.3 Ordinary location certification

As standard, the device has been examined and tested to determine that the design meets the basic electrical, mechanical, and fire protection requirements by a nationally recognized test laboratory (NRTL) as accredited by the Federal Occupational Safety and Health Administration (OSHA).

1.4 Environmental conditions

Table 1-1: Environmental Conditions (Ordinary Location and Low Voltage Directive (LVD))

| Type | Description |
|-----------------------------------|--|
| Location | Indoor or outdoor use, wet |
| Maximum altitude | 6562 ft. (2000 m) |
| Ambient temperature | -40 to 176 °F (-40 to 80 °C) |
| Electrical supply/load | 20-264 Vac 50-60 Hz, 20-60 Vdc, 500 mA |
| Mains supply voltage fluctuations | Safe at ±10% |
| Overtoltage category | II @ 264 Vmax, III @ 150 Vmax |
| Pollution degree | Housing code A, D: 2 Housing code X, Y, S, T: 4 |

1.5 Installing equipment in North America

The US National Electrical Code® (NEC) and the Canadian Electrical Code (CEC) permit the use of Division marked equipment in Zones and Zone marked equipment in Divisions. The markings must be

suitable for the area classification, gas, and temperature class. This information is clearly defined in the respective codes.

1.6 U.S.A.

1.6.1 G5 Ordinary Location

| | |
|--------------------|--|
| Certificate | FM20NUS0006 |
| Standards | FM Class 3810:2011; ANSI/NEMA 250:1991 |
| Markings | Type 4X |

1.6.2 IS Intrinsic Safety and Non-incendive

| | |
|--------------------|--|
| Certificate | FM17US0355X |
| Standards | FM Class 3600:2018; FM Class 3610:2010; FM Class 3611:2004; FM 3810:2005; ANSI/ISA 60079-0:2005; ANSI/ISA 60079-11:2009 |
| Markings | IS Class I, Division 1, Groups A, B, C, and D, T5...T3 IS: Class I, Zone 0, AEx ia IIC, T5...T3 NI: Class I, Division 2, Groups A, B, C and D, T5...T3 NI: Class I, Zone 2, IIC, T5...T3 When installed per Control Drawing 71097/1314 or 71097/1154 |

| Safety parameter | Namur | 8/16 mA |
|-------------------|---------|----------|
| Voltage U_i | 15 V | 30 V |
| Current I_i | 32 mA | 93 mA |
| Power P_i | 0.1 W | 0.65 W |
| Capacitance C_i | 211 nF | 12 nF |
| Inductance L_i | 0.06 mH | 0.035 mH |

The applicable temperature class, ambient temperature range and process temperature range of the equipment is as follows:

| Temperature class / Maximum surface temperature | Ambient temperature range (T_a) | Process temperature range (T_p) |
|---|--|-------------------------------------|
| T3 | $-40\text{ °C} \leq T_a \leq 50\text{ °C}$ | -40 °C to 150 °C |
| T4 | $-40\text{ °C} \leq T_a \leq 60\text{ °C}$ | -40 °C to 115 °C |
| T5 | $-40\text{ °C} \leq T_a \leq 80\text{ °C}$ | -40 °C to 60 °C |

Specific Conditions of Use (X):

1. The enclosure is constructed from plastic. To prevent the risk of electrostatic sparking the plastic surface should only be cleaned with a damp cloth.

1.6.3 E5 Explosion-proof

| | |
|--------------------|---|
| Certificate | FM20US0047 |
| Standards | FM Class 3600:2018; FM 3615:2018; FM3810:2005; ANSI/NEMA 250:1991 |
| Markings | XP CL I, Div 1, GRPS A, B, C, and D, T6...T3 Type 4X |

The applicable temperature class, ambient temperature range and process temperature range of the equipment is as follows:

| Temperature class / Maximum surface temperature | Ambient temperature range (Ta) | Process temperature range (Tp) |
|---|--------------------------------|--------------------------------|
| T3 | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T4 | -40 °C ≤ Ta ≤ 65 °C | -40 °C to 125 °C |
| T5 | -40 °C ≤ Ta ≤ 70 °C | -40 °C to 95 °C |
| T6 | -40 °C ≤ Ta ≤ 75 °C | -40 °C to 75 °C |

1.7 Canada

1.7.1 G6 Ordinary location

| | |
|--------------------|--|
| Certificate | 80096118 |
| Standards | CAN/CSA-C22.2 No. 61010-1-04; CAN/CSA-C22.2 No. 94-M91 |
| Markings | Type 4X |

1.7.2 I6 Intrinsic Safety and Non-Incendive

| | |
|--------------------|--|
| Certificate | 80051772 |
| Standards | CSA Std C22.2 No. 0-M91(R 2006); CSA C22.2 No. 157-M1992 (R 2006); CAN/CSA-C22.2 No. 94-M91 (R 2006); CSA Std C22.2 No. 142-M1987 (R 2004); CAN/CSA E60079-11:02; ANSI/ISA - 12.27.01-2003 |
| Markings | Class I, Division 1, Groups A, B, C, and D, T5...T3 IS: Class I, Zone 0, Ex ia IIC, T5...T3 |

NI: Class I, Division 2, T5...T3

When installed per Control Drawing 71097/1179
(Namur) or 71097/1315 (8/16mA)

| Safety parameter | Namur | 8/16 mA |
|-------------------|---------|----------|
| Voltage U_i | 15 V | 30 V |
| Current I_i | 32 mA | 93 mA |
| Power P_i | 0.1 W | 0.65 W |
| Capacitance C_i | 211 nF | 12 nF |
| Inductance L_i | 0.06 mH | 0.035 mH |

The applicable temperature class, ambient temperature range and process temperature range of the equipment is as follows:

| Temperature class / Maximum surface temperature | Ambient temperature range (T_a) | Process temperature range (T_p) |
|---|--|--|
| T3 | $-40\text{ °C} \leq T_a \leq 50\text{ °C}$ | -40 °C to 150 °C |
| T4 | $-40\text{ °C} \leq T_a \leq 60\text{ °C}$ | -40 °C to 115 °C |
| T5 | $-40\text{ °C} \leq T_a \leq 80\text{ °C}$ | -40 °C to 60 °C |

The enclosure is constructed from plastic. To prevent the risk of electrostatic sparking the plastic surface should only be cleaned with a damp cloth.

1.7.3 E6 Explosion-proof


| | |
|--------------------|---|
| Certificate | 80051772 |
| Standards | CSA Std C22.2 No. 0-M91(R 2006); CSA Std C22.2 No. 30-M1986 (R 2003); CAN/CSA-C22.2 No. 94-M91 (R 2006); CSA Std C22.2 No. 142-M1987 (R 2004); ANSI/ISA - 12.27.01-2003 |
| Markings | Class I, Division 1, Groups A, B, C, and D, T6...T3 Type 4X. Single Seal. |

The applicable temperature class, ambient temperature range and process temperature range of the equipment is as follows:

| Temperature class / Maximum surface temperature | Ambient temperature range (Ta) | Process temperature range (Tp) |
|---|--|--------------------------------|
| T3 | $-40\text{ °C} \leq T_a \leq 50\text{ °C}$ | -40 °C to 150 °C |
| T4 | $-40\text{ °C} \leq T_a \leq 65\text{ °C}$ | -40 °C to 125 °C |
| T5 | $-40\text{ °C} \leq T_a \leq 70\text{ °C}$ | -40 °C to 90 °C |
| T6 | $-40\text{ °C} \leq T_a \leq 75\text{ °C}$ | -40 °C to 75 °C |

1.8 Europe

1.8.1 I1 ATEX Intrinsic Safety

| | |
|--------------------|--|
| Certificate | Sira 05ATEX2130X |
| Standards | EN IEC 60079-0:2018; EN 60079-11:2012; EN 60079-26:2015 |
| Markings |  II 1 G D Ex ia IIC T5...T3 Ga 8/16 mA: Ex ia IIIC T ₂₀₀ 85°C...T ₂₀₀ 155°C Da (metallic enclosure) 8/16 mA: Ex ia IIIC T ₂₀₀ 90°C...T ₂₀₀ 155°C Da (plastic enclosure) NAMUR: Ex ia IIIC T ₂₀₀ 85°C...T ₂₀₀ 155°C Da IP66 |

| Safety parameter | Namur | 8/16 mA |
|----------------------------|---------|----------|
| Voltage U _i | 15 V | 30 V |
| Current I _i | 32 mA | 93 mA |
| Power P _i | 0.1 W | 0.65 W |
| Capacitance C _i | 12 nF | 12 nF |
| Inductance L _i | 0.06 mH | 0.035 mH |

Specific Conditions of Use (X):

- When the Vibrating Fork Liquid Level Sensor is used with process mediums that have a temperature in excess 80°C, then the internal temperature of the electronics enclosure shall not exceed this value.

2. The following precautions are applicable dependent upon the material used to construct the enclosure:
 - Metallic enclosures - The metallic alloy used for the enclosure material may be at the accessible surface of this equipment; in the event of rare incidents, ignition sources due to impact and friction sparks could occur. This shall be considered when the Vibrating Fork Liquid Level Sensor is being installed in locations that specifically require group II, category 1G equipment.
 - Plastics enclosures - Under certain extreme circumstances, the non-metallic parts incorporated in the enclosure of the Vibrating Fork Liquid Level Sensor may generate an ignition-capable level of electrostatic charge. Therefore, when they are used for applications that specifically require group II, category 1 equipment, the Vibrating Fork Liquid Level Sensor shall not be installed in a location where the external conditions are conducive to the build-up of electrostatic charge on such surfaces. Additionally, the Vibrating Fork Liquid Level Sensor shall only be cleaned with a damp cloth.


3. The temperature class and the maximum surface temperature for dust (T**°C) are defined by the appropriate ambient temperature and process temperature and are given in the charts below:

| Temperature class / Maximum surface temperature | Ambient temperature range (Ta) | Process temperature range (Tp) |
|--|--|--------------------------------|
| Gas Groups Ga | | |
| T3 | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T4 | -40 °C ≤ Ta ≤ 60 °C | -40 °C to 115 °C |
| T5 | -40 °C ≤ Ta ≤ 80 °C | -40 °C to 60 °C |
| Dust Groups Da | | |
| T ₂₀₀ 155°C | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T ₂₀₀ 120°C | -40 °C ≤ Ta ≤ 60 °C | -40 °C to 115 °C |
| NAMUR: T ₂₀₀ 85°C 8/16 mA: T ₂₀₀ 85°C ⁽¹⁾ 8/16 mA: T ₂₀₀ 90°C ⁽²⁾ | NAMUR: -40 °C ≤ Ta ≤ 80 °C 8/16 mA: -40 °C ≤ Ta ≤ 64 °C | -40 °C to 60 °C |

(1) *Metallic enclosure.*

(2) Plastic enclosure.

1.8.2 E1 ATEX Flameproof

| | |
|--------------------|---|
| Certificate | Sira 05ATEX1129X |
| Standards | EN IEC 60079-0:2018/AC:2020-02; EN 60079-1:2014/AC:2018-09; EN 60079-26:2015; EN 60079-31:2014 |
| Markings |  II 1/2 G D Ex db IIC T6...T3 Ga/Gb Ex tb IIIC T85 °C...T160 °C Db |

Specific Conditions of Use (X):

1. The temperature class and the maximum surface temperature for dust (T**°C) are defined by the appropriate ambient temperature and process temperature and are given in the chart below:

| Temperature class / Maximum surface temperature | Ambient temperature range | Process temperature range |
|---|---------------------------|---------------------------|
| T3 (T160°C) | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T4 (T135°C) | -40 °C ≤ Ta ≤ 65 °C | -40 °C to 125 °C |
| T5 (T100°C) | -40 °C ≤ Ta ≤ 70 °C | -40 °C to 90 °C |
| T6 (T85°C) | -40 °C ≤ Ta ≤ 75 °C | -40 °C to 75 °C |

2. When coated with a non-standard paint the enclosure is non-conducting and may generate an ignition-capable level of electrostatic charges under certain extreme conditions. The user should ensure that the equipment is not installed in a location where it may be subjected to external conditions which might cause a build-up of electrostatic charges on non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

1.9 International

1.9.1 I7 IECEX Intrinsic Safety

| | |
|--------------------|--|
| Certificate | IECEX SIR 06.0070X |
| Standards | IEC 60079-0:2017; IEC 60079-11:2011 |
| Markings | Ex ia IIC T5...T3 Ga 8/16 mA: Ex ia IIIC T ₂₀₀ 85°C...T ₂₀₀ 155°C Da (metallic enclosure) 8/16 mA: Ex ia IIIC T ₂₀₀ 90°C...T ₂₀₀ 155°C Da (plastic enclosure) NAMUR: Ex ia IIIC T ₂₀₀ 85°C...T ₂₀₀ 155°C Da |

| Safety parameter | Namur | 8/16 mA |
|----------------------------|---------|----------|
| Voltage U _i | 15 V | 30 V |
| Current I _i | 32 mA | 93 mA |
| Power P _i | 0.1 W | 0.65 W |
| Capacitance C _i | 12 nF | 12 nF |
| Inductance L _i | 0.06 mH | 0.035 mH |

Specific Conditions of Use (X):

1. When the Vibrating Fork Liquid Level Sensor is used with process mediums that have a temperature in excess 80°C, then the internal temperature of the electronics enclosure shall not exceed this value.
2. The following precautions are applicable dependent upon the material used to construct the enclosure:
 - Metallic enclosures - The metallic alloy used for the enclosure material may be at the accessible surface of this equipment; in the event of rare incidents, ignition sources due to impact and friction sparks could occur. This shall be considered when the Vibrating Fork Liquid Level Sensor is being installed in locations that specifically require group II, category 1G equipment.
 - Plastics enclosures - Under certain extreme circumstances, the non-metallic parts incorporated in the enclosure of the Vibrating Fork Liquid Level Sensor may generate an ignition-capable level of electrostatic charge. Therefore, when they are used for applications that specifically require group II, category 1 equipment, the Vibrating Fork Liquid Level Sensor shall not be installed in a location where

the external conditions are conducive to the build-up of electrostatic charge on such surfaces. Additionally, the Vibrating Fork Liquid Level Sensor shall only be cleaned with a damp cloth.

- The temperature class and the maximum surface temperature for dust (T**°C) are defined by the appropriate ambient temperature and process temperature and are given in the charts below:

| Temperature class / Maximum surface temperature | Ambient temperature range (Ta) | Process temperature range (Tp) |
|--|--|--------------------------------|
| Gas Groups Ga | | |
| T3 | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T4 | -40 °C ≤ Ta ≤ 60 °C | -40 °C to 115 °C |
| T5 | -40 °C ≤ Ta ≤ 80 °C | -40 °C to 60 °C |
| Dust Groups Da | | |
| T ₂₀₀ 155°C | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T ₂₀₀ 120°C | -40 °C ≤ Ta ≤ 60 °C | -40 °C to 115 °C |
| NAMUR: T ₂₀₀ 85°C 8/16 mA: T ₂₀₀ 85°C ⁽¹⁾ 8/16 mA: T ₂₀₀ 90°C ⁽²⁾ | NAMUR: -40 °C ≤ Ta ≤ 80 °C 8/16 mA: -40 °C ≤ Ta ≤ 64 °C | -40 °C to 60 °C |

- Metallic enclosure.*
- Plastic enclosure.*

1.9.2 E7 IECEx Flameproof

| | |
|--------------------|--|
| Certificate | IECEX SIR 06.0051X |
| Standards | IEC 60079-0:2017; IEC 60079-1:2014-06; IEC 60079-26:2014-10; IEC 60079-31:2013 |
| Markings | Ex db IIC T6...T3 Ga/Gb Ex tb IIIC T85 °C...T160 °C Db |

Specific Conditions of Use (X):

- The temperature class and the maximum surface temperature for dust (T**°C) are defined by the appropriate ambient temperature and process temperature and are given in the chart below:

| Temperature class / Maximum surface temperature | Ambient temperature range (Ta) | Process temperature range (Tp) |
|---|--------------------------------|--------------------------------|
| T3 (T160°C) | -40 °C ≤ Ta ≤ 50 °C | -40 °C to 150 °C |
| T4 (T135°C) | -40 °C ≤ Ta ≤ 65 °C | -40 °C to 125 °C |
| T5 (T100°C) | -40 °C ≤ Ta ≤ 70 °C | -40 °C to 90 °C |
| T6 (T85°C) | -40 °C ≤ Ta ≤ 75°C | -40 °C to 75 °C |

- When coated with a non-standard paint the enclosure is non-conducting and may generate an ignition-capable level of electrostatic charges under certain extreme conditions. The user should ensure that the equipment is not installed in a location where it may be subjected to external conditions which might cause a build-up of electrostatic charges on non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

1.10 Republic of Korea

1.10.1 IP Intrinsic Safety

Certificate 13-KB4BO-0143X, 20-KA4BO-0962X

Markings Ex ia IIC T5...T3 Ga
Ta (see table in the certificate)

| Safety parameter | 8/16 mA |
|-------------------|----------|
| Voltage U_i | 30 V |
| Current I_i | 93 mA |
| Power P_i | 0.65 W |
| Capacitance C_i | 12 nF |
| Inductance L_i | 0.035 mH |

Specific Conditions of Use (X):

See certificate.

1.10.2 EP Flameproof

Certificate 13-KB4BO-0144X, 17-KA4BO-0243X, 20-KA4BO-0967X, 20-KA4BO-0968X

Markings Ex db IIC T6...T3 Ga/Gb

Ex tb IIIC T85°C ...T160°C Db
Ta (see table in the certificate)

Specific Conditions of Use (X):

See certificate.

1.11 China

1.11.1 I3 Intrinsic Safety

Certificate GYJ20.1389X (CCC)

Markings Ex ia IIC T5...T3 Ga – All Models
Ex ia IIIC T₂₀₀85°C...T₂₀₀155°C Da – NAMUR Models fitted in either metallic or non-metallic housings
Ex ia IIIC T₂₀₀85°C...T₂₀₀155°C Da – 8/16mA Models fitted in metallic housings only
Ex ia IIIC T₂₀₀90°C...T₂₀₀155°C Da – 8/16mA Models fitted in non-metallic housings only

Specific Conditions of Use (X):

See certificate.

1.11.2 E3 Flameproof

Certificate GYJ20.1390X (CCC)

Markings Ex db IIC T6...T3 Ga/Gb
Ex tb IIIC T85°C...T160°C Db

Specific Conditions of Use (X):

See certificate.

1.12 Technical Regulations Customs Union (TR-CU)



TR CU 020/2011 "Electromagnetic Compatibility of Technical Products"

TR CU 004/2011 "On safety of low-voltage equipment"

TR TC 032/2013 "On the safety equipment of high pressure"

Certificate EAЭC KZ 7500525.01.01.01708



TR CU 012/2011 “On safety of equipment intended for use in explosive atmospheres”

1.12.1 IM Technical Regulations Customs Union (EAC) Intrinsic Safety

| | |
|--------------------|--|
| Certificate | EAЭC KZ 7500525.01.01.01906 |
| Markings | 0Ex ia IIC T5...T2 Ga X Ex ia IIIC T ₂₀₀ 85°C...T ₂₀₀ 155°C Da X Ta (see table in the certificate) |

Specific Conditions of Use (X):

See certificate.

1.12.2 EM Technical Regulations Customs Union (EAC) Flameproof

| | |
|--------------------|---|
| Certificate | EAЭC KZ 7500525.01.01.01906 |
| Markings | 0/1Ex db IIC T6...T3 Ga/Gb X Ex tb IIIC T85°C...T160°C Db X Ta (see table in the certificate) |

Specific Conditions of Use (X):

See certificate.

1.13 Brazil

1.13.1 I2 INMETRO Intrinsic Safety

| | |
|--------------------|---|
| Certificate | UL-BR 18.0441X (Sweden), UL-BR 23.0981X (USA) |
| Standards | ABNT NBR IEC 60079-0:2020, ABNT NBR IEC 60079-11:2013, ABNT NBR IEC 60079-26:2016 |
| Markings | Ex ia IIC T5...T3 Ga Ex ia IIIC T85°C...T155°C Da Ta (see table in the certificate) |

Specific Conditions of Use (X):

See certificate.

1.13.2 E2 INMETRO Flameproof

| | |
|--------------------|--|
| Certificate | UL-BR 18.0284X (Sweden), UL-BR 23.0982X (USA) |
| Standards | ABNT NBR IEC 60079-0:2020, ABNT NBR IEC 60079-1:2020, ABNT NBR IEC 60079-26:2016, ABNT NBR IEC 60079-31:2014 |
| Markings | Ex db IIC T6...T3 Ga/Gb Ex tb IIIC T85°C...T160°C Db Ta (see table in the certificate) |

Specific Conditions of Use (X):

See certificate.

1.14 Japan

1.14.1 I4 Japan Intrinsic Safety

| | |
|--------------------|---|
| Certificate | CML 23JPN2030X |
| Standards | JNIOSH-TR-46-1:2020, JNIOSH-TR-46-6:2015 |
| Markings | Ex ia IIC T5...T3 Ga Ta (see table in the certificate) |

Specific Conditions of Use (X):

See certificate.

1.14.2 E4 Japan Flameproof

| | |
|--------------------|--|
| Certificate | CML 22JPN1264X |
| Standards | JNIOSH-TR-46-1:2020, JNIOSH-TR-46-2:2018 |
| Markings | Ex db IIC T6...T3 Ga/Gb Ta (see table in the certificate) |

Specific Conditions of Use (X):

See certificate.

1.15 United Arab Emirates

1.15.1 Flameproof

| | |
|--------------------|--|
| Certificate | 23-11-22694/Q23-11-048838/NB0002, 23-11-22710/Q23-11-048839/NB0002, |
|--------------------|--|

| | |
|-----------------|---|
| | 24-01-22812/Q23-11-048840/NB0002, 23-11-22737/Q23-12-048887/NB0002 |
| Markings | Same as IECEx (E7) |

1.15.2 Intrinsic Safety

| | |
|--------------------|---|
| Certificate | 23-11-22694/Q23-11-048838/NB0002, 23-11-22710/Q23-11-048839/NB0002, 24-01-22812/Q23-11-048840/NB0002, 23-11-22737/Q23-12-048887/NB0002 |
| Markings | Same as IECEx (I7) |

1.16 India

1.16.1 IW Intrinsic Safety

| | |
|--------------------|----------------------|
| Certificate | PESO P480759/2 |
| Markings | Ex ia IIC T5...T3 Ga |

1.16.2 EW Flameproof

| | |
|--------------------|-------------------------|
| Certificate | PESO P480759/1 |
| Markings | Ex db IIC T6...T3 Ga/Gb |

1.17 Marine Type Approvals

1.17.1 American Bureau of Shipping (ABS) Type Approval

| | |
|-------------------------|---|
| Certificate | 22-2288029-PDA |
| Intended Service | Marine and Offshore Application – Level detection system used for high level or overflow alarm functions fitted on board of ACC and ACCU vessels. |

1.17.2 Det Norske Veritas (DNV) Type Approval

| | |
|---------------------|---|
| Certificate | TAA00001RX |
| Intended Use | DNV rules for classification – Ships, offshore units, and high speed and light craft. |

1.17.3 Korean Register (KR) Type Approval

| | |
|--------------------|----------------|
| Certificate | SGP34681-AE004 |
|--------------------|----------------|

1.18 Functional safety

1.18.1 QT Safety-certified to IEC 61508:2010 with certificate of FMEDA data

Certificate exida ROS 20-09-098 C001

1.19 NAMUR Compliance

Suitable for intended use

Compliant with NAMUR NE 95:2013, "Basic Principles of Homologation"

1.20 Overfill prevention

1.20.1 U1 Germany – WHG

Certificate Z-65.11-522

Application TÜV tested and approved by DIBt for overfill prevention according to the German WHG regulations.

1.20.2 Switzerland -SVTI

Certificate KVU 302.043

1.20.3 Belgium - VlareM

Certificate VIL/35/P017110041/NL/002

Standards VlareM II Chapter 5.17
VlareM II Annex 5.17.7

1.21 Pressure approvals

1.21.1 Canadian Registration Number (CRN)

Certificate 0F04227.2C

The requirements of CRN are met when a Rosemount 2120 CSA-approved vibrating fork level switch model is configured with 316/316L stainless steel (1.4401/1.4404) process-wetted parts and either NPT threaded or 2-in. to 4-in. ASME B16.5 flanged process connections.

1.22 Hygienic certificates and approvals

1.22.1 QA 3-A®

Certificate Authorization Number 3626

Standard 3-A Sanitary Standards for Number 74-07 (Sensors and Sensor Fittings and Connections)

1.22.2 QE EHEDG

Certificate Number EHEDG-C2200010

Certification Type EL CLASS I

1.22.3 QH FDA 21


1.22.4 QB ASME-BPE

1.22.5 EC 1935/2004


1.22.6 Instructions for hygienic installations

It is the responsibility of the user to ensure:

1. The materials listed in [Materials of construction](#) are suitable for the media and cleaning/sanitisation processes.
2. The installation of the level switch is drainable and cleanable.
3. That the joint requirements between the fork and the vessel/ pipe are compatible with the process media, applicable standards, and code of practice.
4. The product contact surfaces are not scratched.
5. The level switch is suitable for installation on pipeline (with fork gap in line with the flow) and on closed vessels (with the fork gap vertical). EHEDG only recommend horizontal stub mounting in pipelines:

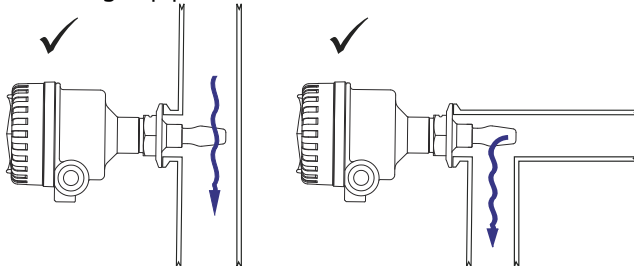

6. The seals/gaskets used conform to the EHEDG Position Paper “Easy cleanable pipe couplings and process connections”. Note that a special gasket is required for Tri Clamp connections, as specified in the EHEDG Position Paper.
7. If the level switch is installed in a stub then to ensure cleanability, the length (L) must meet the criteria $L < (D - 23)$, where D is the stub diameter.



1.22.7 Materials of construction

The hygienic approvals and certificates of the level switch relies upon the following materials used in its construction:

Table 1-2: Product contact surfaces

| Item | Material |
|------|--------------------------|
| Fork | Stainless steel 316/316L |

Table 1-3: Non-product contact surfaces

| Item | Material |
|---------------------|---|
| Enclosure (metal) | Aluminum alloy ASTM B85 360.0 or ANSI AA360.0 |
| Enclosure (plastic) | Glass-filled (30%) nylon 66 |
| Seals | Silicone, Nitrile rubber and polyethylene |
| Cable entry devices | Nylon (PA6) |

1.22.8 Clean-In-Place (CIP)

Withstands cleaning routines up to 160 °F (71 °C)

1.22.9 Steam-In-Place (SIP) cleaning

Withstands cleaning routines up to 275 °F (135 °C)

1.23 Control drawings

Figure 1-1: 71097/1154 – FM Intrinsically Safe Control Drawing

ORIGINALFORMAT A3

INTRINSICALLY SAFE APPARATUS

HAZARDOUS LOCATION
CLASS I, DIVISION 1 & 2, GROUPS A, B, C, D
CLASS I, ZONES O.1 & 2, GROUPS IIA, IIB, IIC.

2130N**C** 2120T**K**

| Temperature Classes | Minimum Ambient Air Temperature (Ta) | Maximum Process Temperature (Tb) |
|---------------------|--------------------------------------|----------------------------------|
| T5, T4, T3, T2, T1 | 80°C | 60°C |
| T4, T3, T2, T1 | 80°C | 115°C |
| T3, T2, T1 | 71°C | 135°C |
| T2, T1 | 50°C | 150°C |

Minimum Ambient Air Temperature (Ta) = -40°C
Minimum Process Temperature (Tb) = -40°C

2130N**E*****S*

| Temperature Classes | Minimum Ambient Air Temperature (Ta) | Maximum Process Temperature (Tb) |
|---------------------|--------------------------------------|----------------------------------|
| T5, T4, T3, T2, T1 | 80°C | 80°C |
| T4, T3, T2, T1 | 69°C | 115°C |
| T3, T2, T1 | 50°C | 130°C |

Minimum Ambient Air Temperature (Ta) = -50°C
Minimum Process Temperature (Tb) = -10°C

ASSOCIATED APPARATUS

NON-HAZARDOUS LOCATION

IT MUST NOT BE SUPPLIED FROM A SOURCE OF NORMAL OR ABNORMAL CONDITIONS, A SOURCE OF TOUGHNESS, OR A SOURCE OF GROUND IN EXCESS OF 250V RMS OR 250V DC.

APPROVED SINGLE CHANNEL ISOLATOR OR ONE CHANNEL OF MULTI-CHANNEL ISOLATOR

SEE TABLE 1 FOR ENTITY CONCEPT PARAMETERS

SEE NOTE 3

CABLE SEE NOTE 5

SCREEN/ EARTH

NOTE: ANI.S SAFETY EARTH IS NOT REQUIRED WHEN A GALVANIC ISOLATOR IS USED. IF USED, IT MUST BE GROUNDING POINT ONLY OR NOT AT ALL.

| | | | | | | | | |
|-------|----------------|------|-------|----------------|------|-------|----------------|------|
| ISSUE | MOF. ORDER NO. | WEEK | ISSUE | MOF. ORDER NO. | WEEK | ISSUE | MOF. ORDER NO. | WEEK |
| 10 | MOB-027114 | 41 | | | | | | |

NOTES-

1. INSTALLATION OF EQUIPMENT TO BE IN ACCORDANCE WITH NEC ARTICLES 504 AND 505 AND ISAR P12.8. RECOMMENDED PRACTICE FOR INSTALLATION OF INTRINSICALLY SAFE SIGNALS.
2. THE ELECTRICAL CIRCUIT IN THE HAZARDOUS LOCATION MUST BE CAPABLE OF WITHSTANDING A SHORT CIRCUIT OF 300V RMS TO GROUND ON THE FRAME OF THE APPARATUS FOR 1 MINUTE.
3. THE ENTITY CONCEPT ALLOWS INTERCOMBINATION OF INTRINSICALLY SAFE APPARATUS NOT SPECIFICALLY EXAMINED IN COMBINATION AS A SYSTEM WHEN THE APPROVED VALUES OF (Ia), (Ib), (Ic) AND (Is) OF THE ASSOCIATED APPARATUS ARE GREATER THAN THE APPROVED VALUES OF Ca AND Ia OF THE ASSOCIATED SAFE APPARATUS AND THE APPROVED VALUES OF Cb AND Ib OF THE ASSOCIATED INTRINSICALLY SAFE APPARATUS. THE TOTAL VALUES Ca AND Ib OF ALL THE INTRINSICALLY SAFE APPARATUS INCLUDING ALL THE SIGNALS.
4. FOR FURTHER INFORMATION REFER TO MANUAL:
 - 2130 00650-0100-4130
 - 2130 00650-0100-4130
5. CABLE CAPACITANCE AND INDUCTANCE PLUS THE I.S. APPARATUS UNPROTECTED CAPACITANCE (Ca) AND INDUCTANCE (L) MUST NOT EXCEED THE ALLOWED CAPACITANCE (Cb) AND INDUCTANCE (Lb) INDICATED ON THE ASSOCIATED APPARATUS.
6. SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY.
7. NON-INCLUSIVE-
 - INSTALLATION OF EQUIPMENT TO BE IN ACCORDANCE WITH NEC ARTICLES 501 & 505.
 - INSTALLATION IS NOT PERMITTED USING ANY OF THE WIRING METHODS PERMITTED FOR UNCLASSIFIED LOCATION.

TABLE 1

UNIT ENTITY CONCEPT PARAMETERS

| DESCRIPTION | VALUE | CUI DIV1 |
|----------------------------|---------|-----------|
| MAXIMUM INPUT VOLTAGE (Ui) | 15V | CU1 ZHO.1 |
| MAXIMUM INPUT CURRENT (Ii) | 10mA | |
| MAXIMUM INPUT POWER (Pi) | 0.15W | |
| INTERNAL CAPACITANCE (Ci) | 21nF | |
| INTERNAL INDUCTANCE (Li) | 0.008mH | |

NON-INCLUSIVE FIELD WIRING PARAMETERS

| DESCRIPTION | VALUE |
|------------------------------|---------|
| MAXIMUM INPUT VOLTAGE (Vmax) | 15V |
| MAXIMUM INPUT CURRENT (Imax) | 20mA |
| INTERNAL CAPACITANCE (C) | 21nF |
| INTERNAL INDUCTANCE (L) | 0.008mH |

PRELIMINARY

| | | | | | | | |
|---|--|--|--|--|--|--|--|
| A | | | | | | | |
|---|--|--|--|--|--|--|--|

| | | | | | | | |
|------------------------|----|-----------------------|----|----------------------------|------|-----------|--|
| DESIGNED BY | mb | WEEK | 25 | PRODUCT CODE | X | MATERIAL | --- |
| APPROVED BY | X | WEEK | 0 | DOC. TYPE | ACAD | FILE | FM INTRINSICALLY SAFE CONTROL DRAWING 21202130 |
| FOR MACHINING: SD 2748 | | FOR ASSEMBLY: SD 2748 | | FOR WELDING: SS-SI 81 1300 | | SCALE | 1:1 |
| | | | | | | DRW. NO. | 71097/1154 |
| | | | | | | ISSUE NO. | 10 / 1/1 |

ROSE MOUNT

CERTIFIED PRODUCT. ALTERATIONS TO THIS DOCUMENT ARE NOT PERMITTED BEFORE IMPLEMENTATION.

THIS IS A PRELIMINARY DRAWING. IT IS SUBJECT TO CHANGE WITHOUT NOTICE.

Figure 1-2: 71097/1314 – FM Intrinsically Safe Control Drawing

| | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| ORIG/FORMAT A3 | | INTRINSICALLY SAFE APPARATUS | | | | | | | | | | | | | |
| HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D | HAZARDOUS LOCATION CLASS 1, ZONES 0, 1 & 2, GROUPS IIA, IIB, IIC | HAZARDOUS LOCATION GROUPS A, B, C, D |
| 3 | MOB-02714 | 41 | WEEK | MOOD. ORDER NO. | WEEK | MOOD. ORDER NO. | WEEK | MOOD. ORDER NO. | WEEK | MOOD. ORDER NO. | WEEK | MOOD. ORDER NO. | WEEK | MOOD. ORDER NO. | WEEK |

| | | | | | | | | | | | | | | | | | |
|---|--------------------|------|--------------------|------|--------------------|-------|--------------------|-------|--|--------------------|------|--------------------|------|--------------------|------|--------------------|-------|
| <p style="text-align: center;">210**** Temperature Classes Maximum Ambient Air Temperature (Ta) Maximum Process Temperature (Tp)</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td>TS, T4, T3, T2, T1</td><td>60°C</td></tr> <tr><td>TS, T4, T3, T2, T1</td><td>80°C</td></tr> <tr><td>TS, T4, T3, T2, T1</td><td>110°C</td></tr> <tr><td>TS, T4, T3, T2, T1</td><td>150°C</td></tr> </table> <p style="text-align: center;">Minimum Ambient Air Temperature (Tb) = -40°C Minimum Process Temperature (Tb) = -40°C</p> | TS, T4, T3, T2, T1 | 60°C | TS, T4, T3, T2, T1 | 80°C | TS, T4, T3, T2, T1 | 110°C | TS, T4, T3, T2, T1 | 150°C | <p style="text-align: center;">2130M**** Temperature Classes Maximum Ambient Air Temperature (Ta) Maximum Process Temperature (Tp)</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td>TS, T4, T3, T2, T1</td><td>60°C</td></tr> <tr><td>TS, T4, T3, T2, T1</td><td>80°C</td></tr> <tr><td>TS, T4, T3, T2, T1</td><td>71°C</td></tr> <tr><td>TS, T4, T3, T2, T1</td><td>185°C</td></tr> </table> <p style="text-align: center;">Minimum Ambient Air Temperature (Tb) = -20°C Minimum Process Temperature (Tb) = -70°C</p> | TS, T4, T3, T2, T1 | 60°C | TS, T4, T3, T2, T1 | 80°C | TS, T4, T3, T2, T1 | 71°C | TS, T4, T3, T2, T1 | 185°C |
| TS, T4, T3, T2, T1 | 60°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 80°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 110°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 150°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 60°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 80°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 71°C | | | | | | | | | | | | | | | | |
| TS, T4, T3, T2, T1 | 185°C | | | | | | | | | | | | | | | | |

ASSOCIATED APPARATUS

NON-HAZARDOUS LOCATION
UNSPECIFIED EXCEPT THAT THIS EQUIPMENT IS LOCATED IN A NON-HAZARDOUS LOCATION FROM NOW ON UNDER NORMAL OR ABNORMAL CONDITIONS AND IS NOT A SOURCE OF POTENTIAL WITH RESPECT TO HAZARDOUS LOCATIONS.
250V RMS OR 250V DC

NOTES:

- INSTALLATION OF EQUIPMENT TO BE IN ACCORDANCE WITH IEC ARTICLES 504 AND 505, AND SA NP2'S RECOMMENDED PRACTICE FOR INSTALLATION OF INTRINSICALLY SAFE CIRCUITS.
- THE ELECTRICAL CIRCUIT IN THE HAZARDOUS LOCATION MUST BE CAPABLE OF WITHSTANDING THE FULL VOLTAGE AND INDUCTIVE LOAD OF ALL THE INTRINSICALLY SAFE APPARATUS INCLUDING ALL THE CAPACITANCE (Cs) AND INDUCTANCE (Ls) INDICATED ON THE ASSOCIATED APPARATUS.
- THE ENTITY CONCEPT ALLOWS INTERCONNECTION OF INTRINSICALLY SAFE APPARATUS NOT SPECIFICALLY EXAMINED IN COMBINATION AS A SYSTEM WHEN THE APPROVED VALUES OF Co AND Lo OF THE INTRINSICALLY SAFE APPARATUS AND THE APPROVED VALUES OF Cs AND Ls OF THE ASSOCIATED APPARATUS ARE LESS THAN OR EQUAL TO (1/2) (Vmax) AND (1/2) (Imax) OF THE INTRINSICALLY SAFE APPARATUS INCLUDING ALL THE CAPACITANCE (Cs) AND INDUCTANCE (Ls) INDICATED ON THE ASSOCIATED APPARATUS.
- FOR FURTHER INFORMATION REFER TO MANUAL.

210: 100969-0100-4000
213: 100969-0100-4000

| DESCRIPTION | VALUE | CU/DVI |
|------------------------------|--------|-----------|
| MINIMUM INPUT VOLTAGE (Vmin) | 90V | CU/DVI1.1 |
| MAXIMUM INPUT CURRENT (Imax) | 500mA | |
| MAXIMUM INPUT POWER (Pmax) | 0.95W | |
| INTERNAL CAPACITANCE (Cs) | 120pF | |
| INTERNAL INDUCTANCE (Ls) | 0.50mH | |

NON-INTRINSIC SAFETY FIELD WIRING PARAMETERS

| DESCRIPTION | VALUE |
|------------------------------|--------|
| MAXIMUM INPUT VOLTAGE (Vmax) | 30V |
| INTERNAL CAPACITANCE (Cs) | 120pF |
| INTERNAL INDUCTANCE (Ls) | 0.50mH |

TABLE 1
UNIT ENTITY CONCEPT PARAMETERS

| | | | | | | | |
|-------------|-----|-----|----|--------------|---|-----------|------|
| ISSUED BY | GYP | REV | 38 | PRODUCT CODE | X | SOC. TYPE | ACAD |
| APPROVED BY | HEX | X | 0 | FILE | X | FILE | X |

| | | |
|--|---------------------------|--------------|
| FM INTRINSICALLY SAFE CONTROL DRAWING 8/18/16A | DWG NO. 71097/1314 | SHEET 3 / 11 |
|--|---------------------------|--------------|

THIS DRAWING IS THE PROPERTY OF EMERSON ELECTRIC AND POWER TOOL COMPANY. IT IS TO BE USED ONLY FOR THE PROJECT AND FOR WHICH IT WAS PREPARED. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM EMERSON ELECTRIC AND POWER TOOL COMPANY.


ROSEMOUNT

CERTIFIED PRODUCT
DOCUMENT MUST BE APPROVED
BEFORE IMPLEMENTATION

20

www.Emerson.com

Figure 1-3: 71097/1179 – CSA Intrinsically Safe Control Drawing

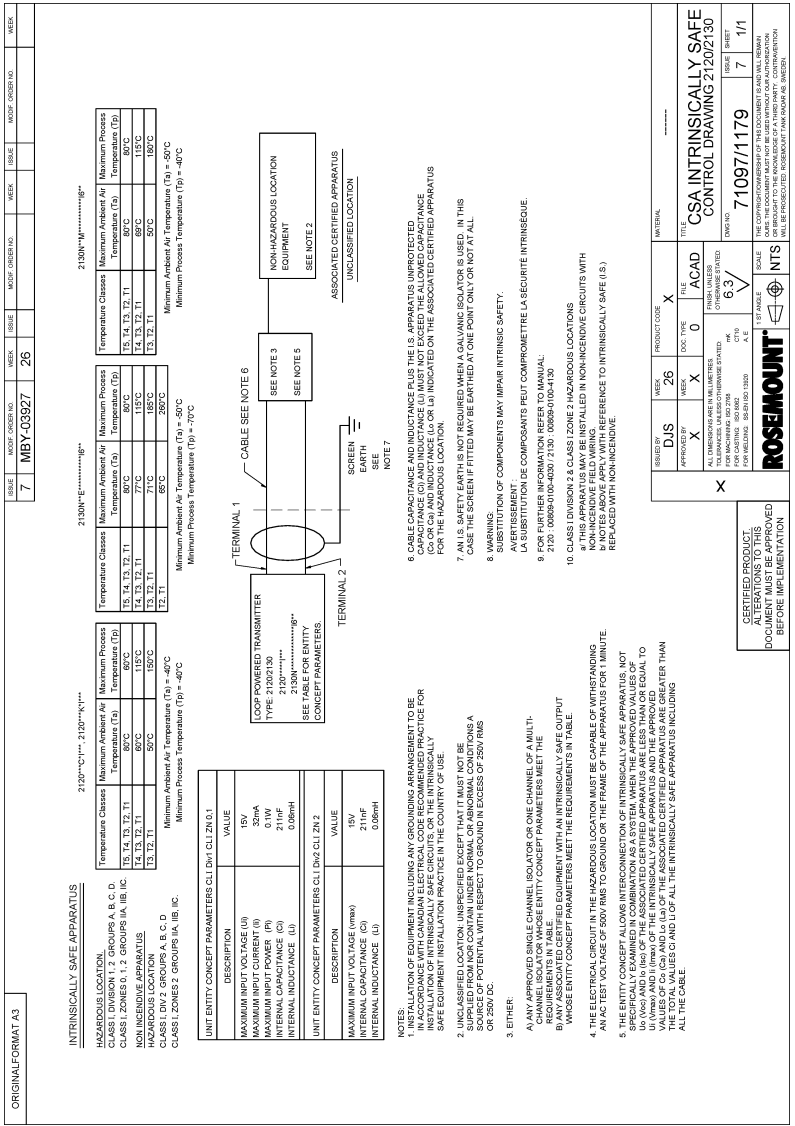

DESIGNED BY: DJS

APPROVED BY: X

FOR MACHINE: 5027298

FOR MACHINES: 5027298

FOR MACHINES: 5027298

DATE: 26

DOC. TYPE: X

REV: 0

SCALE: 6.3

UNIT: A, E

PROJECT CODE: X

FILE: ACAD

SCALE: 1:1

SCALE: 6.3

SCALE: 1:1

ROSEMOUNT

INTEGRITY. INNOVATION. INSPIRATION.

CSA INTRINSICALLY SAFE CONTROL DRAWING 2130/2130

71097/1179


7 / 1/1

SCALE: 1:1

SCALE: 6.3


SCALE: 1:1

Figure 1-4: 71097/1315 – CSA Intrinsically Safe Control Drawing

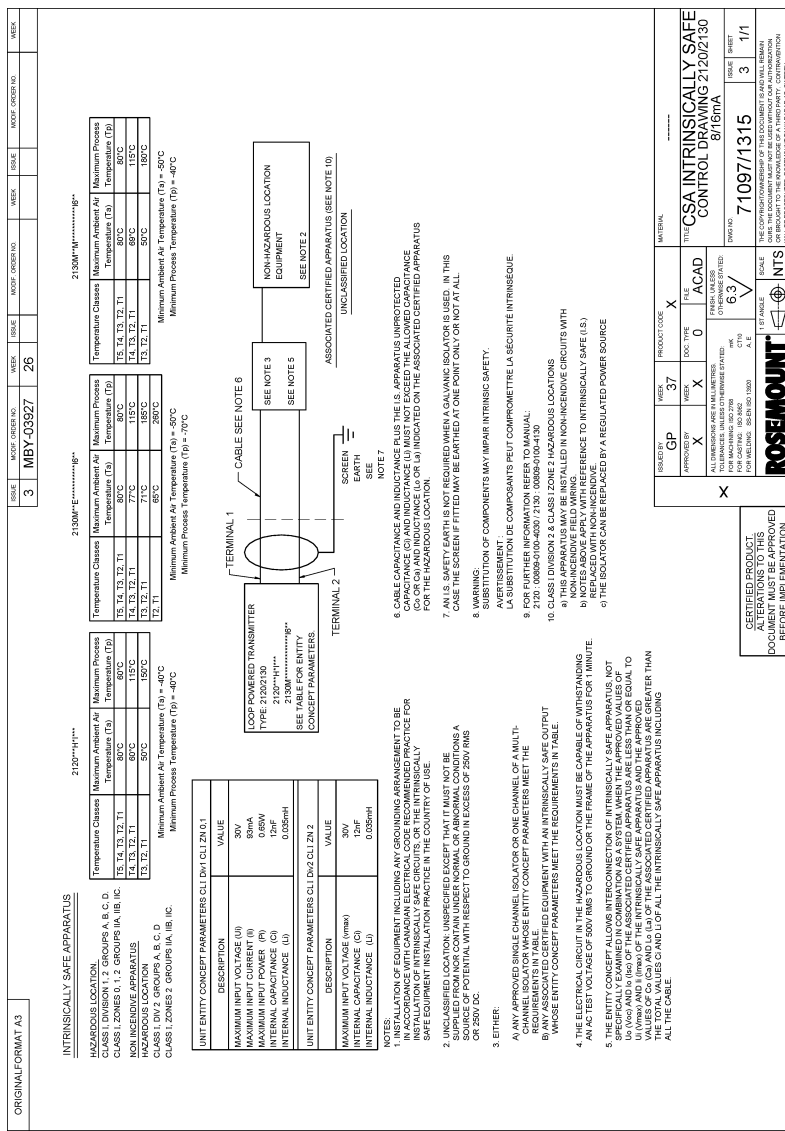


1.24 EU Declaration of Conformity

Figure 1-5: EU Declaration of Conformity



Declaration of Conformity



Rev. #3

We,

Rosemount Tank Radar AB
Layoutvägen 1
S-435 33 MÖLNLYCKE
Sweden

declare under our sole responsibility that the product,


Rosemount™ 2120 Series Vibrating Fork Liquid Level Switch

manufactured by,

Rosemount Tank Radar AB
Layoutvägen 1
S-435 33 MÖLNLYCKE
Sweden

to which this declaration relates, is in conformity with the provisions of the European Union Directives, including the latest amendments, as shown in the attached schedule.

Assumption of conformity is based on the application of the harmonized standards and, when applicable or required, a European Union notified body certification, as shown in the attached schedule.

| | |
|--|---|
|  <hr style="border: 0.5px solid black;"/> <p>(signature)</p> | <p>Sr. Manager Product Approvals</p> <hr style="border: 0.5px solid black;"/> <p>(function)</p> |
| <p>Dajana Prastalo</p> <hr style="border: 0.5px solid black;"/> <p>(name)</p> | <p>28-Nov-23; Mölnlycke</p> <hr style="border: 0.5px solid black;"/> <p>(date of issue & place)</p> |

Page 1 of 4



Declaration of Conformity

EMC Directive (2014/30/EU)

Rosemount 2120***K***** (Namur cassette)
 Harmonized Standards:
 EN 61326-1:2013;
 EN 61326-2-3:2013;
 EN 60947-5-6:2001

Rosemount 2120***V***** (Relay Mains cassette)
 Rosemount 2120***G***** (PNP/PLC cassette)
 Rosemount 2120***H***** (8/16mA cassette)
 Harmonized Standards:
 EN 61326-1:2013;
 EN 61326-2-3:2013
 Other Standards used:
 EN61326-3-1 :2008

Rosemount 2120***E***** (Relay 12Vdc cassette)
 Rosemount 2120***T***** (Direct Load cassette)
 Harmonized Standards:
 EN 61326-1:2013;
 EN 61326-2-3:2013

Other Standards used:
 IEC 61326-1:2020

ATEX Directive (2014/34/EU)

Sira 05ATEX2130X – Intrinsically safe (Gas & Dust)

Rosemount 2120***K*I***** (Namur cassette)
 Equipment Group II, Category 1GD
 Ex ia IIC T5...T2 Ga
 Ex ia IIIC T85°C...T265°C Da

Rosemount 2120***H*I***** (8/16mA cassette)
 Equipment Group II, Category 1GD
 Ex ia IIC T5...T2 Ga
 Ex ia IIIC T200 85°C...T200 265°C Da (Metallic housings)
 Ex ia IIIC T200 90°C...T200 265°C Da (Non-metallic housings)



Declaration of Conformity

Rosemount 2120***K*18***** ;
 Rosemount 2120***K*18*****R2364 (Namur cassette) ;
 Rosemount 2120***H*18***** ;
 Rosemount 2120***H*18*****R2634 (8/16mA cassette)
 Equipment Group II, Category 1/2G
 Ex ib IIC T5...T2 Ga/Gb
 Equipment Group II, Category 2D
 Ex ib IIIC T85°C...T265°C Db

Harmonized Standards:
 EN IEC 60079-0:2018 ;
 EN 60079-11:2012,
 EN 60079-26:2015

Sira 05ATEX1129X – Flameproof

Rosemount 2120****E1X*****;
 Rosemount 2120****E1S***** (All cassettes, M20 conduits)
 Equipment Group II, Category 1/2G
 Ex db IIC T6...T2 Ga/Gb
 Equipment Group II, Category 2D
 Ex tb IIIC T85°C...T265°C Db

Harmonized Standards:
 EN IEC 60079-0:2018/AC:2020;
 EN 60079-1:2014/AC:2018;
 EN 60079-26:2015;
 EN 60079-31:2014

RoHS Directive (2011/65/EU)

Harmonized Standards: IEC 63000:2018



Declaration of Conformity **CE**

ATEX Directive Notified Body

CSA Group Netherlands B.V. [Notified Body Number: 2813]
Utrechtseweg 310, 6812 AR,
Arnhem, Netherlands

ATEX Notified body for Quality Assurance

DNV Product Assurance AS [Notified Body Number: 2460]
Veritasveien 3
1363 Høvik
Norway



1.25 China RoHS

含有China RoHS管控物质超过最大浓度限值的部件型号列表 Rosemount 2120
List of Rosemount 2120 Parts with China RoHS Concentration above MCVs

| 部件名称 Part Name | 有害物质 / Hazardous Substances | | | | | |
|---------------------------------|-----------------------------|----------------------|----------------------|--|--|--|
| | 铅 Lead (Pb) | 汞 Mercury (Hg) | 镉 Cadmium (Cd) | 六价铬 Hexavalent Chromium (Cr +6) | 多溴联苯 Polybrominated biphenyls (PBB) | 多溴联苯醚 Polybrominated diphenyl ethers (PBDE) |
| 电子组件 Electronics Assembly | O | O | O | O | O | O |
| 壳体组件 Housing Assembly | O | O | O | O | O | O |
| 传感器组件 Sensor Assembly | X | O | O | O | O | O |

本表格系依据SJ/T11364的规定而制作。

This table is proposed in accordance with the provision of SJ/T11364.

O: 意为该部件的所有均质材料中该有害物质的含量均低于GB/T 26572所规定的限量要求。

O: Indicate that said hazardous substance in all of the homogeneous materials for this part is below the limit requirement of GB/T 26572.

X: 意为在该部件所使用的所有均质材料里，至少有一类均质材料中该有害物质的含量高于GB/T 26572所规定的限量要求。

X: Indicate that said hazardous substance contained in at least one of the homogeneous materials used for this part is above the limit requirement of GB/T 26572.



Product Certifications
00825-0300-4030, Rev. AG
September 2024

For more information: [Emerson.com/global](https://www.emerson.com/global)

©2024 Emerson. All rights reserved.

Emerson Terms and Conditions of Sale are available upon request. The Emerson logo is a trademark and service mark of Emerson Electric Co. Rosemount is a mark of one of the Emerson family of companies. All other marks are the property of their respective owners.

ROSEMOUNT™

